


**EXTERIOR ELEVATION**



1/4" = 1'-0"

STRUCTURAL NOTE: CONTRACTOR TO PROVIDE MINIMUM 2' SQUARE X 1'-0" DEEP PIER FOOTINGS W/ BOTTOM OF FOOTING 2'-0" BELOW FINISH GRADE. VERIFY COMPACTED SOIL HAS AT LEAST MINIMUM NECESSARY BEARING CAPACITY TO SUPPORT FOOTING W/O MOVEMENT. NUMBER OF PIERS TO BE DETERMINED BY LUMBER SUPPLIER, BASED ON STRUCTURAL DESIGN OF DECK. CONTRACTOR TO CONSTRUCT 16" SQUARE CMU PIERS CENTERED ON FOOTINGS, GROUT SOLID AT HEIGHT NECESSARY TO SUPPORT STRUCTURAL DROPPED GIRDERS. CONTRACTOR SHALL REMOVE EXISTING GRADE, AND PROVIDE COMPACTED GRAVEL FILL, TO A DEPTH ALLOWING FOR ACCESS TO DECK FOR REPAIRS, AND TO ALLOW FOR ADEQUATE AIR MOVEMENT TO PROHIBIT MILDEW GROWTH. CONTRACTOR SHALL PROVIDE STORM WATER DRAINAGE ADEQUATE TO CARRY ALL WATER AWAY FROM SITE (PARTICULARLY BELOW DECK) WITHIN 12 HOURS OF RAIN.

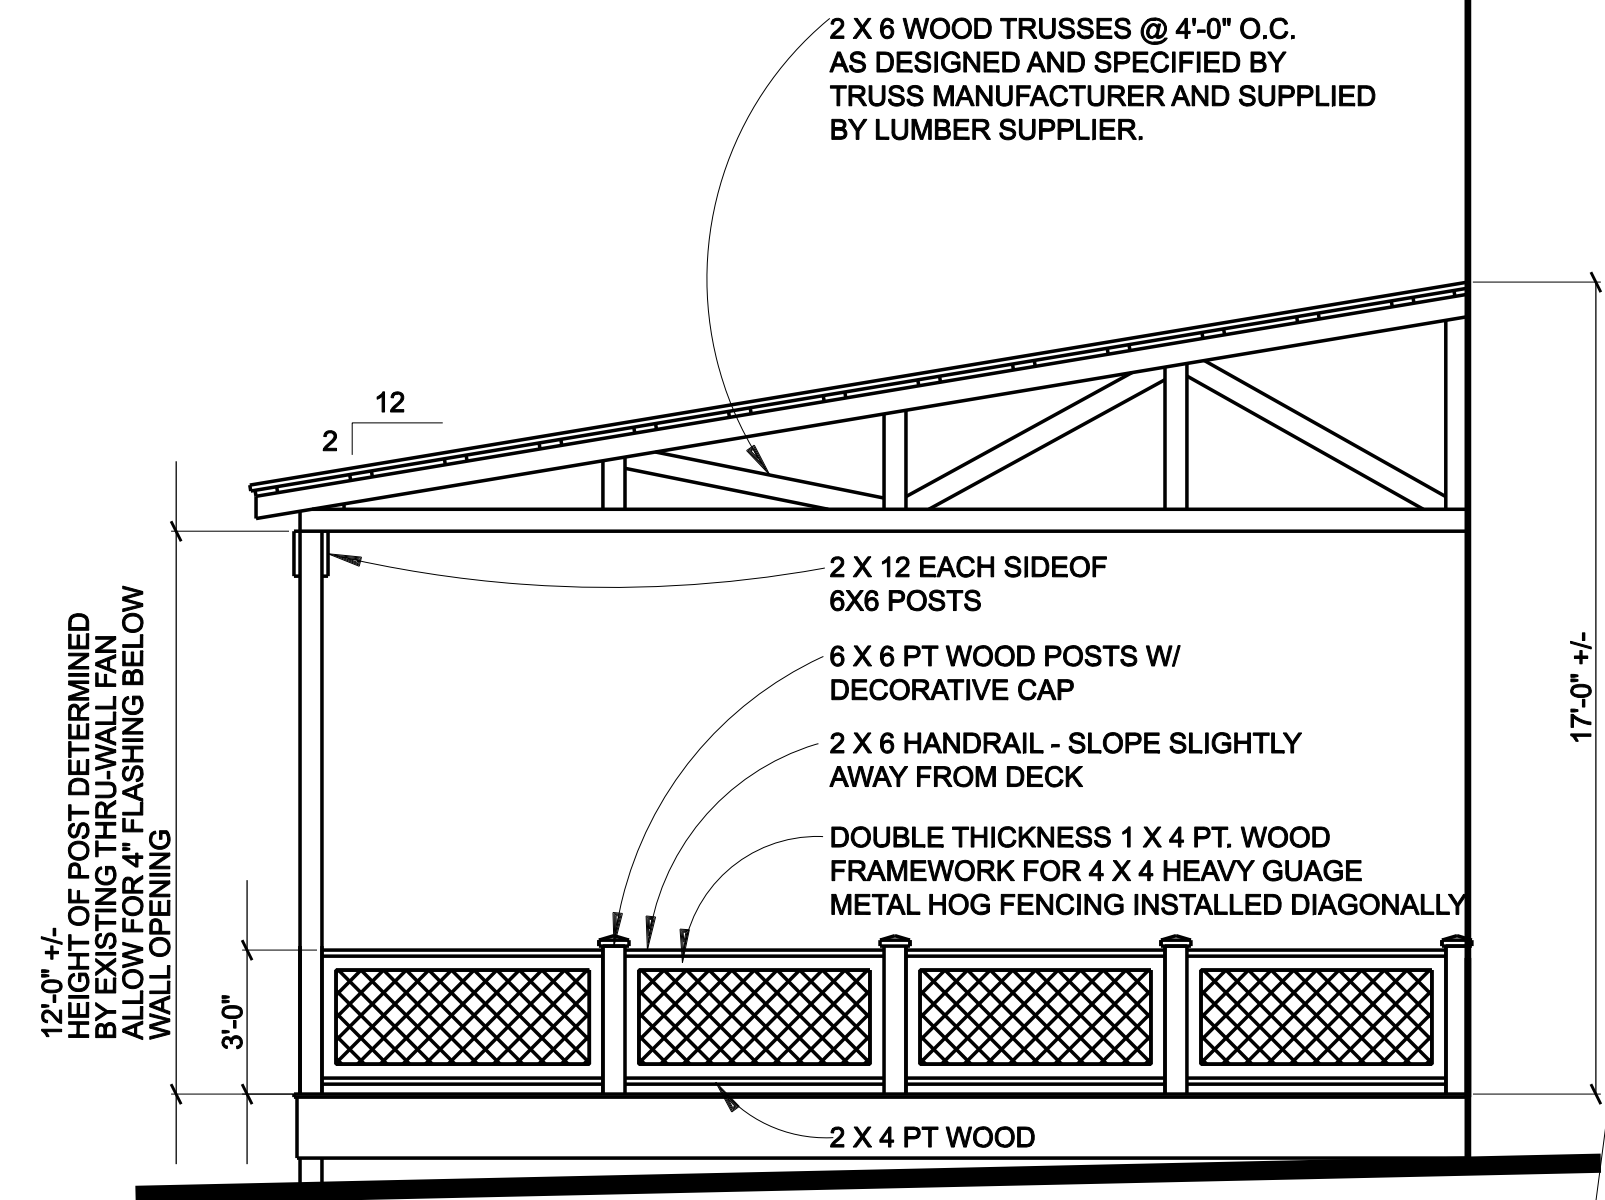

CORRUGATED GALVALUME ROOF OVER 2 X 6 PURLINS @ 2'-0" O.C.

2 X 6 ENGINEERED TRUSSES W/ 2/12 PITCH EXPOSED TAIL ENDS W/ 1'-0" OVERHANG EVENLY SPACE @ 4'-0" O.C. +/- SET ON (2) 2 X 12 HORIZONTAL CLEATS @ EACH SIDE OF 6 X 6 POST.

EMERGENCY LIGHTING AND FIRE SUPPRESSION SYSTEM AS REQUIRED BY BUILDING CODE

12'-0" +/- DETERMINED BY HEIGHT OF EXISTING THRU WALL FAN

PRESSURE TREATED DECK BOARDS OVER 2X STRUCTURE SUPPORTED BY 16" SQUARE PIERS ON 2' X 2' X 1' DP. SPOT FOOTING AS REQUIRED BY LUMBER SUPPLIER. BOTTOM OF FOOTING TO BE MIN. 2'-0" BELOW FINISH GRADE. GROUT SOLID 16" SQUARE CMU PIER.


12'-0" +/- DETERMINED BY HEIGHT OF EXISTING THRU WALL FAN

1'-4" +/- VARIES

2'-0" MIN BELOW FINISH GRADE

**SECTION**

3/4" = 1'-0"

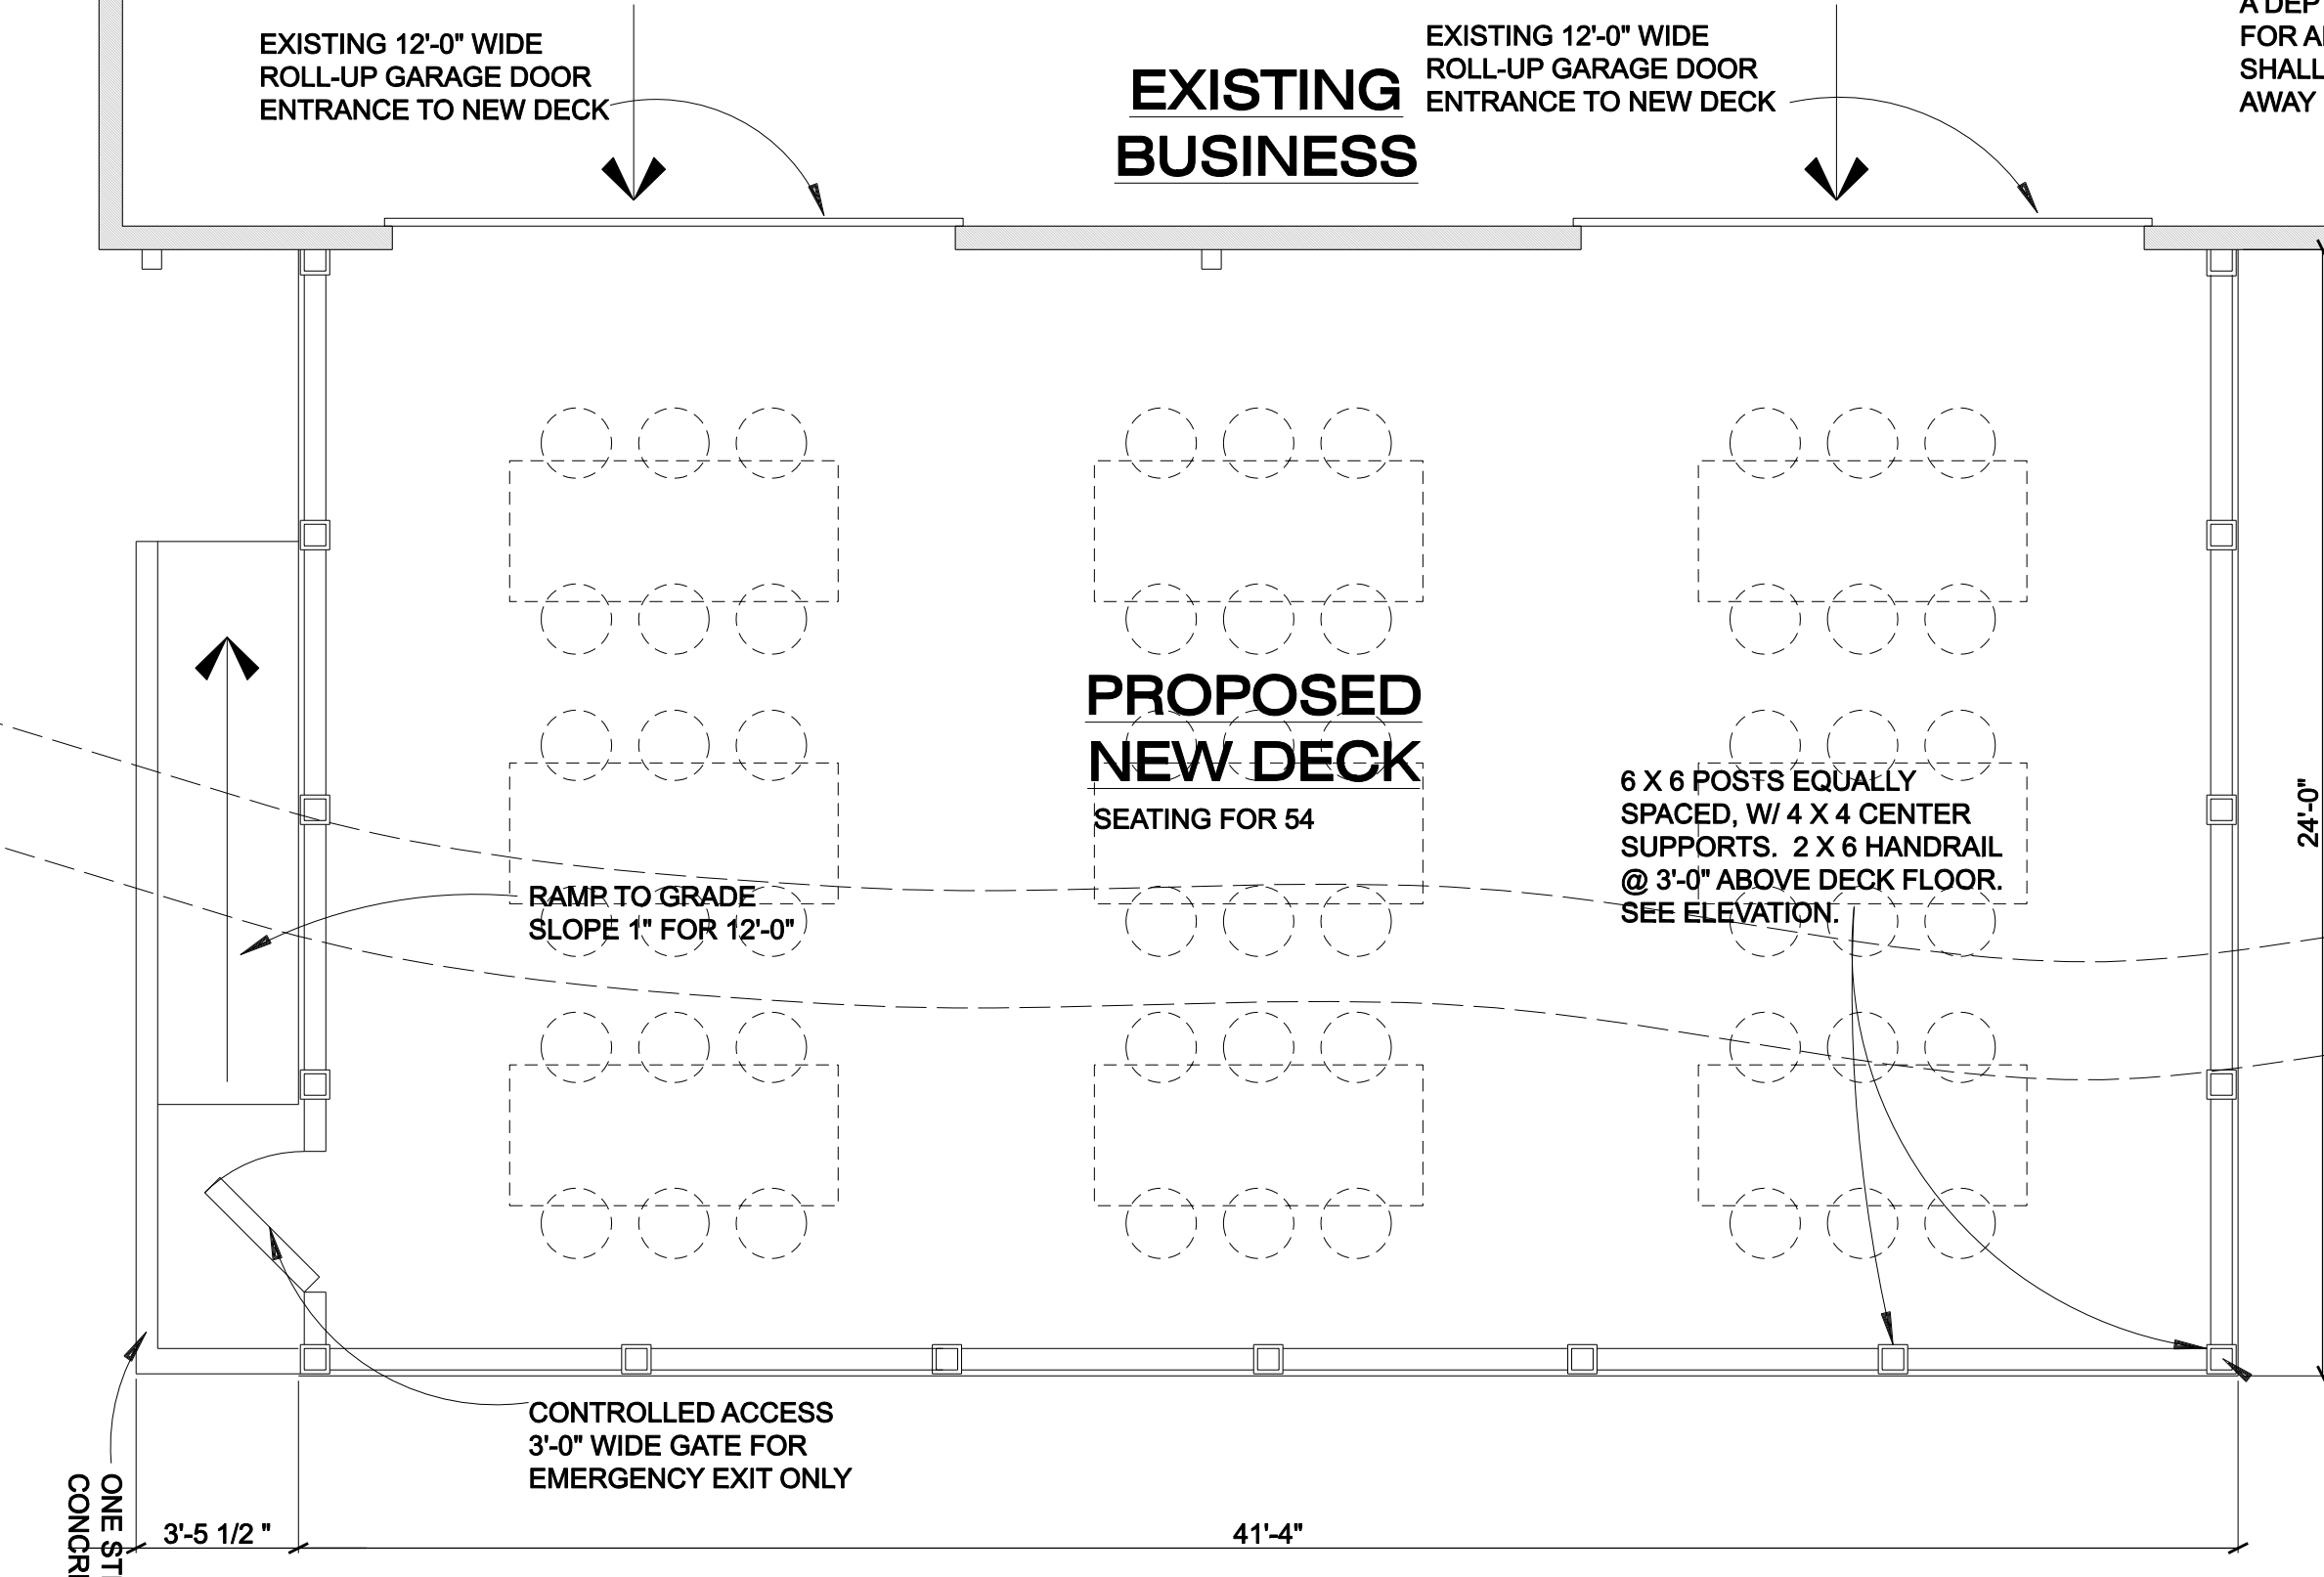

**FLOOR PLAN**



1/4" = 1'-0"

DISCLAIMER: This drawing and design shown are the property of Kristin Harney. The design is preliminary and subject to change without expressed or implied consent of Kristin Harney Architect. It is not to be used for any other project without the written consent of Kristin Harney Architect. It will be subject to legal action.